


Supplementary Figure 1. The pair biomarker P10600-P61812 appears in Table 1 for the pair biomarker identification but it doesn't appear in Table 2. In this figure, the classification accuracies are shown for the involvement of pair biomarker P10600-P61812 in the multi-type biomarker identification.

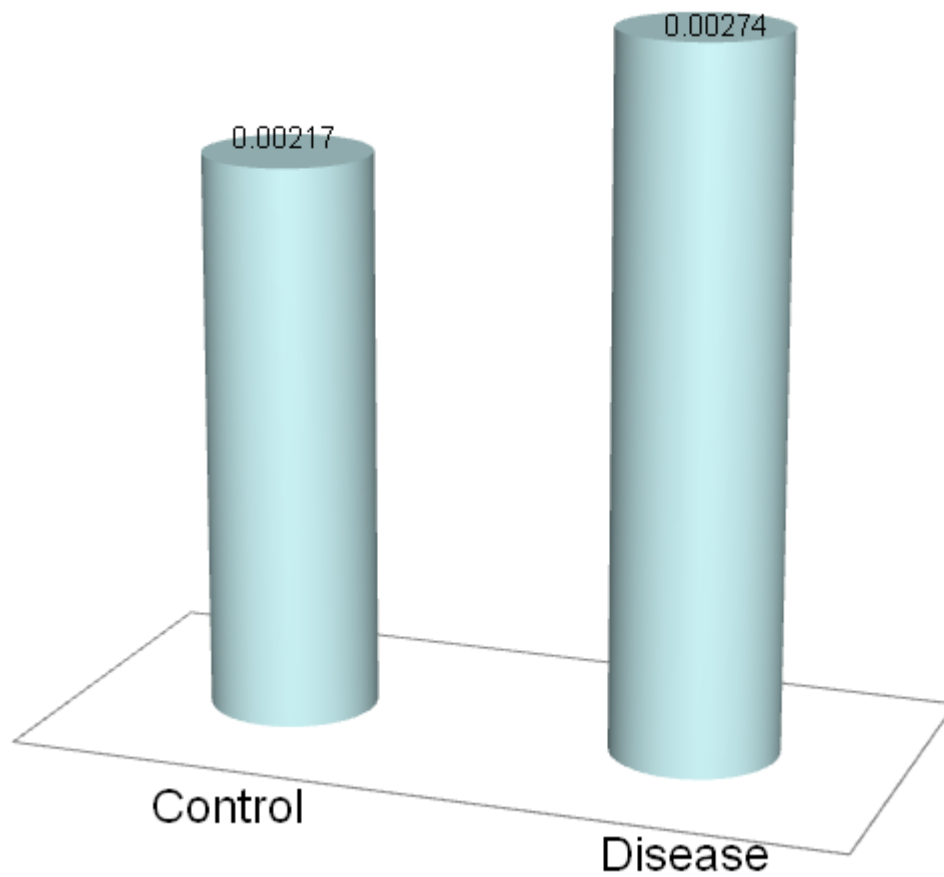

Supplementary Figure 2. The P -value for MPO is less than 0.01 (Student's t test).